MODEL: BL612CF-R

COOLER 35°

MORE (300) 883—8881 GENERAL NOTE NOTEC ID GENERAL CONTRACTOR AND SUB—CONTRACTOR AND SUB—CONTRACTOR WEARING FLOORS. THE METAL FACINGS MAY BE SUS—CEPTIBLE FOR SUB—CONTRACTOR TO STAINING DUE TO EXCESSIVE MOISTURE CREATED BY HYDRA— TION OF CONCRETE—TYPE MATERIALS. IT IS ESSENTIAL THAT EACH ROOM BE PROPERLY VENTILETED. SPECIAL PRECAUTIONS MUST BE TAKEN WHEN USING OF STAINLESS STEIA. MUST BE TAKEN WHEN USING OF STAINLESS STEIA. MUST BE PROTECTED FROM LIME AND OTHER CHEMICALS FOUND IN CONCRETE BY—PRODUCTS. PETROLEUM BASED PROTECTION MUST BE PROTECTED FROM LIME AND OTHER CHEMICALS FOUND IN CONCRETE BY—PRODUCTS. PETROLEUM BASED PROTECTION MUST BE APPLIED BETWEEN CONCRETE AND THE METAL SURFACES. (LIQUID) TAR, BRUSHED. REMOTE PRE-ASSEMBLED REFRIGERATION

MODEL:

COMPT AMP.

INTERIOR/EXTERIOR FINISH

COMPT ELECTRICAL (VOLTS/Hz/PH)

REFRIG. SYSTEM ELECT (VOLTS/Hz/PH)

REFRIG. SYSTEM CONDENSING UNIT AMP.


REFRIG. SYSTEM EVAPORATOR UNIT AMP.

TOTAL SHIP WGHT APPROX. (2 PALLETS)


TOTAL SHIP CUBIC FEET APPROX.

INTERIOR FLOOR FINISH


REFRIG. SYSTEM WEIGHT.



CONDENSING UNIT **DETAIL**



EVAPORATOR MOUNTING DETAIL



PRODUCT SPECIFICATIONS

BL612CF-R

115/60/1

0.8 Amp

15.0 Amp

1.8 Amp

140 Lbs

1506 Lbs

261 CuFt

Energy Independence & Security Act

MILL EMB. ACRYLUME

SMOOTH ALUMINUM

208-230/60/1

APPLICATION: MODEL; BL612CF-R

P.0#:

NOTES:

FLOOR MUST BE LEVEL SMOOTH AND CLEAR OF OBSTRUCTIONS TO ACCEPT WALK-IN PANELS. ALSO, THERE MUST BE A MINIMUM OF 2'
CLEARANCE AROUND ALL SIDES OF
THE WALK-IN UNIT PROPER CIRCULATION.

SURFACES. (LIQUID TAR, BRUSHED OR SPRAYED ABOVE THE CONCRETE CONTACT LINE, HEAVY EPOXY PAINT. 8 MIL POLYETHLYLENE H.D. BLACK DOUBLE LAYERED, 30 LB. ASPHALT

IMPREGNATED ROOFING PAPER).

CONSTRUCTION

N.S.F. CONSTRUCTION

Project Name: ARCTIC INDUSTRIES, INC BLUE LINE

WALK-IN COOLERS AND FREEZERS

VERIFY ALL DIMENSIONS AND SPECIFICATIONS BEUNITE APPROVING DRAWINGS

IMPORTANT: ALLOW 2 FEET CLEARANCE ABOVE UNIT TO REMOVE TOP PANEL AND TO ALLOW SERVICE

STRUCTURE MUST BE NOT MASKED TO BUILDING CEILING, BLOCKING AIR FLOW TO UNIT.

SIGNED APPROVED PRINT MUST BE REC'D. B/4 FAB.


☐ APPROVED AS DRAWN

SIGNED

DATE:


	Drawn By:	Checked By:	
٦	R.PUPO	ARCTIC	
	Scale:	CREATED:	
	NOT TO SCALE	2014	
	DRW	No:	
		_	

BL612CF-R

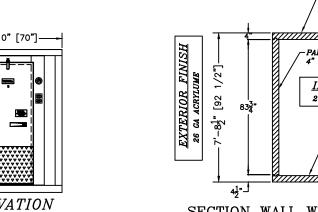

-CEILINGS: 4" INSULATION PANELS: 4" INSULATION INTERIOR FINISH 26 GA ACRYLUME -FLOORS: 4" INSULATION .080 SMOOTH ALUM

SECTION	WALL	WITH	FLOOR
SCALE: 1/4"=1'-0"			



-5'-10" [70"]-

SW1A

BL612-CF

PLAN VIEW

C47S6 F47S6

SW1A

SW47F

[141

 $11'-9\frac{1}{4}"$

SHOWN W/ RIGHT HINGE (LEFT HINGE AVAILABLE)