

MODEL: BL106-C


COOLER 35°

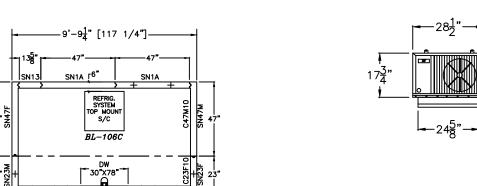

SN30



REFRIGERATION UNIT




[70"]

-10

ີ່ດ

SN30

PLAN VIEW



PRODUCT SPECIFICATIONS	
MODEL:	BL106-C
INTERIOR/EXTERIOR FINISH	MILL EMB. ACRYLUME
COMPT ELECTRICAL (VOLTS/Hz/PH)	115/60/1
COMPT AMP.	0.8 Amp
REFRIG. SYSTEM ELECT (VOLTS/Hz/PH)	208-230/60/1
REFRIG. SYSTEM AMP.	12.0 Amp
CORD + NEMA 6-20P PLUG	
REFRIG. SYSTEM WEIGHT.	195 Lbs
TOTAL SHIP WGHT APPROX. (2 PALLETS)	805 Lbs
TOTAL SHIP CUBIC FEET APPROX.	201 CuFt

ASSIFIE



WALK-IN COOLERS AND FREEZERS BY ARCTIC INDUSTRIES INC. 9731 N.W. 114h WAY MAMI FLORIDA 33178

MORE (300) 883—8881

GENERAL NOTE
NOTEC ID GENERAL CONTRACTOR
AND SUB—CONTRACTOR
AND SUB—CONTRACTOR
WEATHING THE METAL
FACINGS MAY BE SUS—CEPTIBLE
WEARING FLOORS. THE METAL
FACINGS MAY BE SUS—CEPTIBLE
TO STAINING DUE TO EXCESSIVE
MOISTURE CREATED BY HYDRA—
TION OF CONCRETE—TYPE
MATERIALS. IT IS ESSENTIAL THAT
EACH ROOM BE PROPERLY
VENTILETED. SPECIAL PRECAUTIONS
MURIANTE ACID DUE TO EFFECTIONS
MURIANTE ACID DUE TO EFFECTIONS
MURIANTE ACID DUE TO EFFECTIONS
MURIANTE ACID DUE TO EFFECTION
MURIT BE PROTECTED FROM LIME
AND OTHER CHEMICALS FOUND IN
CONCRETE BY—PRODUCTS.
PETROLEUM BASED PROTECTION
MUST BE PROTECTED FROM LIME
AND OTHER CHEMICALS FOUND IN
CONCRETE BY—PRODUCTS.
PETROLEUM BASED PROTECTION
MUST BE APPLIED BETWEEN
CONCRETE AND THE METAL
SURFACES. (LIQUID) TAR, BRUSHED. CONCRETE AND THE METAL SURFACES. (LIQUID TAR, BRUSHED OR SPRAYED ABOVE THE CONCRETE CONTACT LINE, HEAV EPOXY PAINT, 8 MIL POLYETHLYBENE H.D. BLACK DOUBLE LAYERED, 30 LB. ASPHALT IMPRECHATED ROOFING PAPER).

CONSTRUCTION

N.S.F. CONSTRUCTION

Project Name: ARCTIC INDUSTRIES, INC BLUE LINE

P.O#:

APPLICATION:

MODEL; BL106-C

FLOOR MUST BE LEVEL SMOOTH AND CLEAR OF OBSTRUCTIONS TO ACCEPT WALK-IIN PARELS. ALSO, THERE MUST BE A MINIMUM OF 2" CLEARANCE AROUND ALL SIDES OF THE WALK-IIN UNIT PROPER CIRCULATION.

NOTES:

VERIFY ALL DIMENSIONS AND SPECIFICATIONS BEUNITE APPROVING DRAWINGS

IMPORTANT: ALLOW 2 FEET CLEARANCE ABOVE UNIT TO REMOVE TOP PANEL AND TO ALLOW SERVICE

STRUCTURE MUST BE NOT MASKED TO BUILDING CEILING, BLOCKING AIR FLOW TO UNIT.

SIGNED APPROVED PRINT MUST BE REC'D. B/4 FAB.

☐ APPROVED AS DRAWN

SIGNED

DATE:

& Security Act

	Drawn By:	Checked By:
	R.PUPO	ARCTIC
	Scale: NOT TO SCALE	CREATED: 2014
Energy		
Independence	DRW	No:

BL106-C